

MODEL SU-720R

Membrane Type Cross Linked Fully Aromatic Polyamide Composite
Element Configuration Spiral Wound

Performance Specification

NaCl Solution

Salt Rejection ^{1,2}

99.7 %²

Product Flow Rate ^{1,2}

19m³/day (5000 gpd)³

Notes :

1. Test Conditions


Feed Water Pressure	1.5	MPa	(214 psi)
Feed Water Temperature	25	°C	(77 °F)
Feed Water Concentration	1,500	mg/ℓ	as NaCl
Brine Flow Rate	80	ℓ/min.	(21.1 gpm)
Feed Water pH	6.5		

2. 99.4 % minimum*

3. 18 m³/day (6820 gpd) minimum*

*For any single element

Dimensions

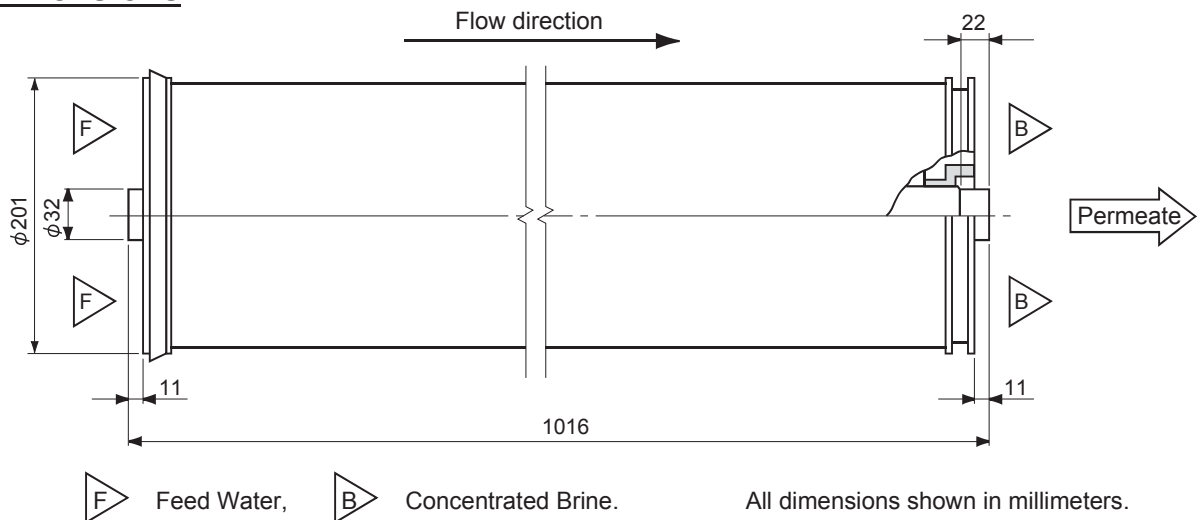

TORAY Industries, Inc. Membrane Products Department.
8-1, Mihama 1-Chome, Urayasu, Chiba 279-8555, Japan

Tel : +81 (47) 350 6030
Fax : +81 (47) 350 6066

TORAY Membrane America, Inc.

USA., South America, Canada

12520 High Bluff Drive, Suite 120,
San Diego, CA 92130, USA

Tel : +1 (858) 523 0476
Fax: +1 (858) 523 0861

ROPUR AG

Europe, Middle East and Africa

Grabenackerstrasse 8
CH-4142 Münchenstein 1, Switzerland

Tel : +41 (61) 415 87 10
Fax: +41 (61) 415 87 20

Design Conditions

	<u>Recommended</u> ¹
Feed Water Pressure ^{2,3}	< 2.0 MPa (300 psi)
Feed Water Temperature ⁴	< 35 °C (95 °F)
Feed Water Turbidity (SDI) ^{2,5}	< 4
Feed Water pH Range, Continuous Operation ⁶	3 – 9
Feed Water pH Range, Chemical Cleaning ⁷	2 – 10
Feed Flow Rate per Vessel	< 200 l/min. (52 gpm)
Brine Flow Rate per Vessel ⁹	> 40 l/min. (11 gpm)
Brine/Permeate Flow Ratio ^{8,9}	> 6
Pressure Drop (per Element) ¹⁰	< 0.10 MPa (14 psi)
Pressure Drop (per Vessel) ¹⁰	< 0.20 MPa (29 psi)

Notes:

1. The recommended design range is operational and design conditions under not so much fouling and scaling. If the SUL-series element are operated outside of the recommended design range, the effective membrane life may be reduced. Refer to the Toray technical bulletin, or contact Toray or local distributor for design guidelines and further information.
2. High flux operation (operation under high permeate flow rate per single element) on feed water turbidity greater than 3 or 4 SDI generally results in frequent cleaning requirements. Operating pressure should be selected to maintain the flux rate, or permeate flow rate per single element.
3. Maximum Feed Water Pressure 4.1 MPa (600 psi)
4. Maximum Feed Water Temperature 40 °C (104 °F)
5. SDI = Silt Density Index measured according to ASTM D4189.
6. Feed and brine water must meet these range.
7. Cleaning chemicals shall be followed to Toray's technical bulletins.
8. Ratio at last element.
9. This figure is reducible when there is less possibility of fouling and scaling.
10. Element(s) must be cleaned when pressure drop increases up to 1.5 times of initial value.

* Sterilization must follow guidances in Toray's technical bulletin.

We accept no responsibility for results obtained by the application of this information or the safety or suitability of our products, either alone or in combination with other products. Users are advised to make their own tests to determine the safety and suitability of each such product or product combination for their own purposes.